

Wall Hung Unit Draining

Applicable Models: i200, i250, iQ251, iQ251D


1

With the power off, isolate the unit by closing the **inlet** and **outlet** isolation valves, and relieve pressure and drain some of the water using the **T&P** valve.



2

Using channel locks, unscrew the inlet strainer, and catch any water with a 5 gallon bucket.

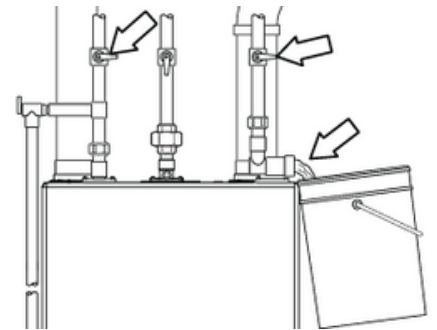

3

Remove the inlet elbow and catch any water that comes out.



Wall Hung Unit Pressurization

Applicable Models: i200, i250, iQ251, iQ251D

Slowly open the **outlet** then **inlet** isolation valves to repressurize the unit, then open a nearby faucet for 2 to 3 minutes before powering back on to purge any air from the system.

